


Shallow source anomaly axes on contoured RTP image

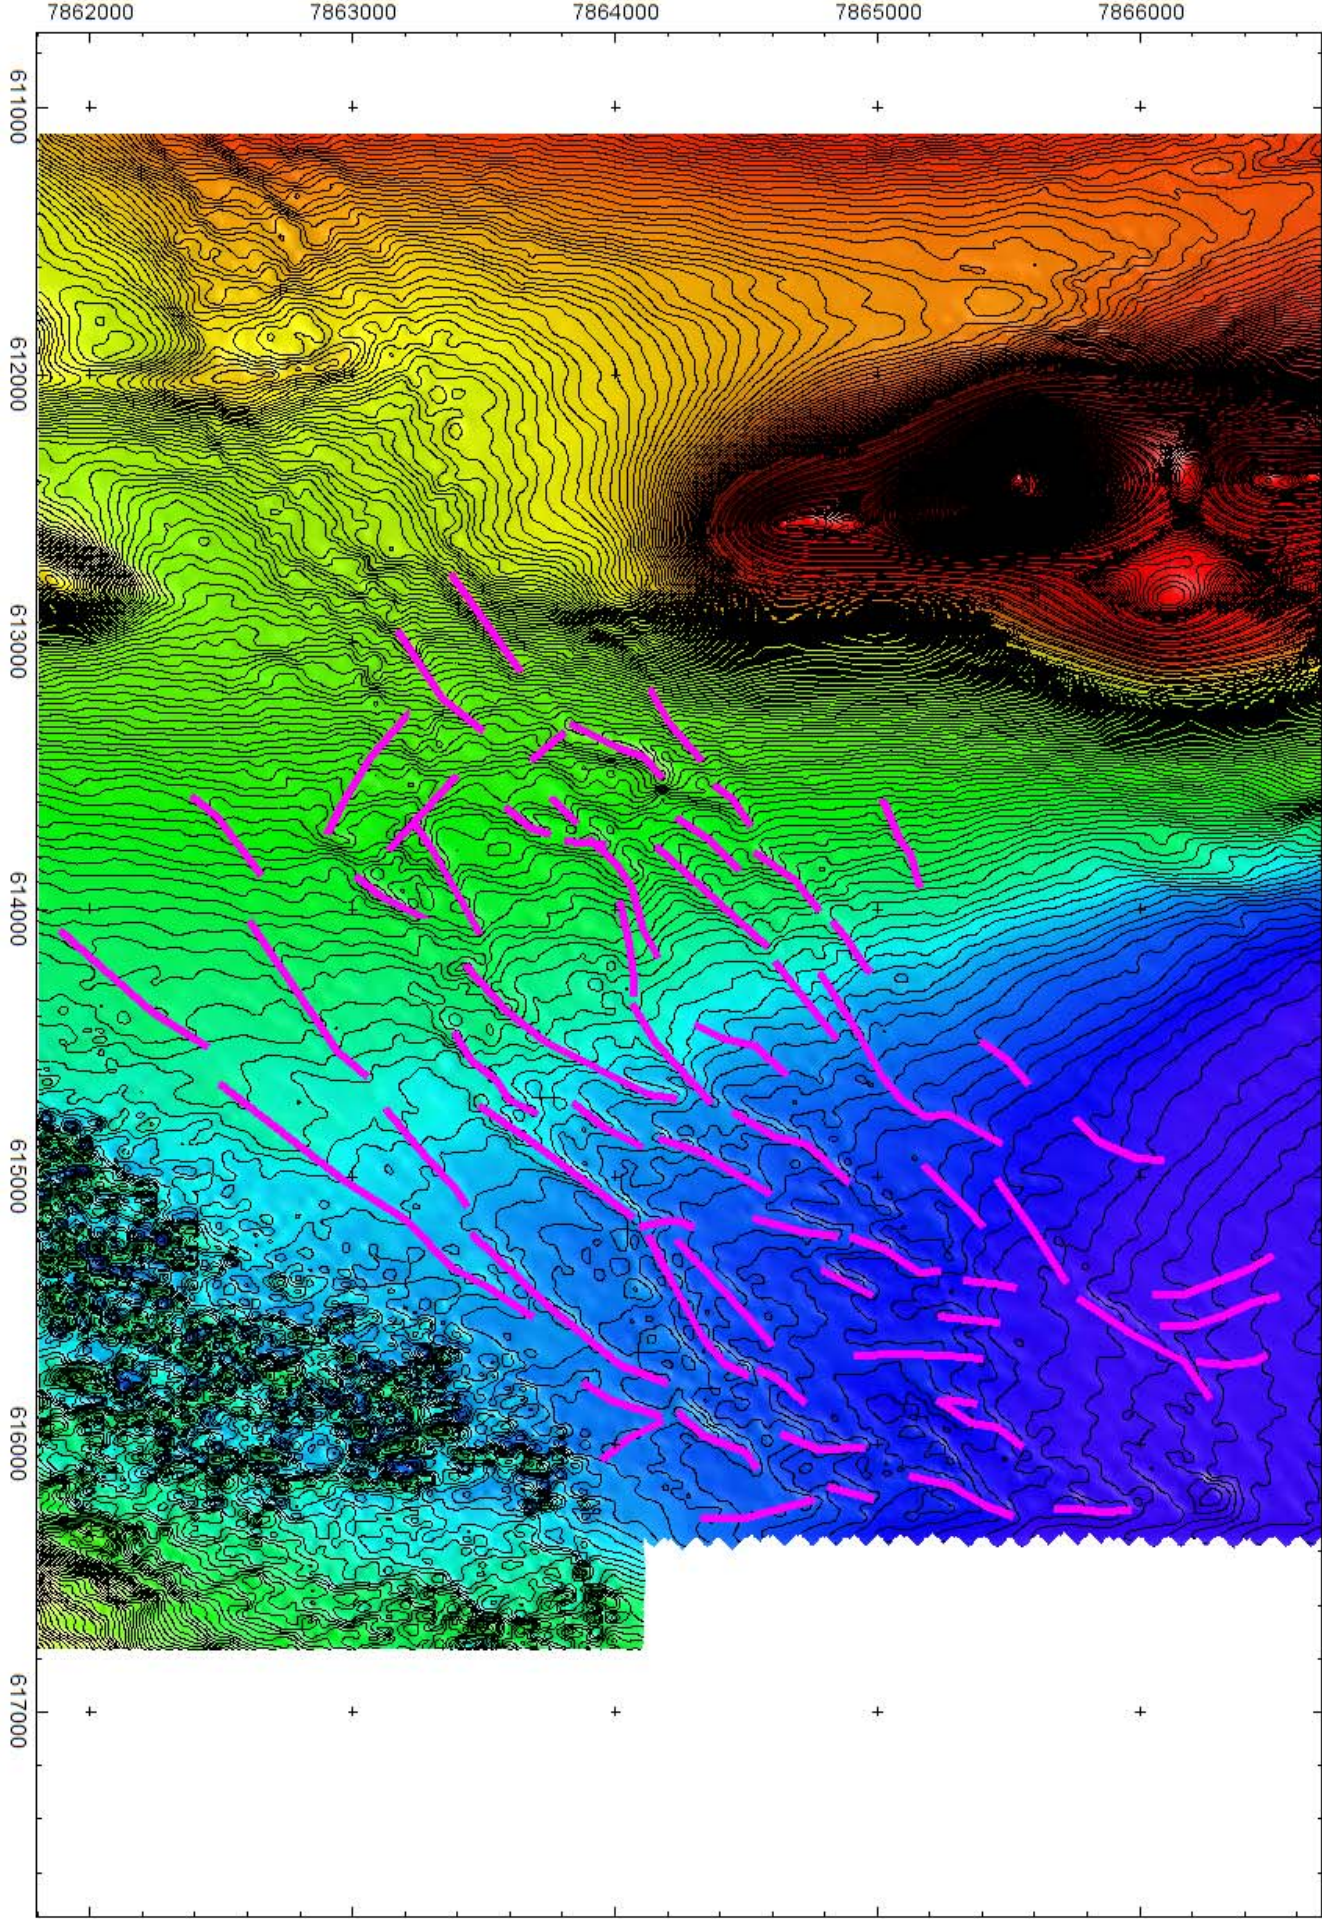

contour interval 2nT

Projection:  
UTM AGD66  
Zone 52

Grid North 0



Enclosure 2

Supplejack Pty Ltd

Axes of shallow-source magnetic anomalies interpreted from the RTP image. Sources may be a combination of distributary channels with detrital magnetite, or magnetization in bedrock fractures.

Scale 1 : 20000



encom