




Observed Apparent Resistivity (Ohm.m)

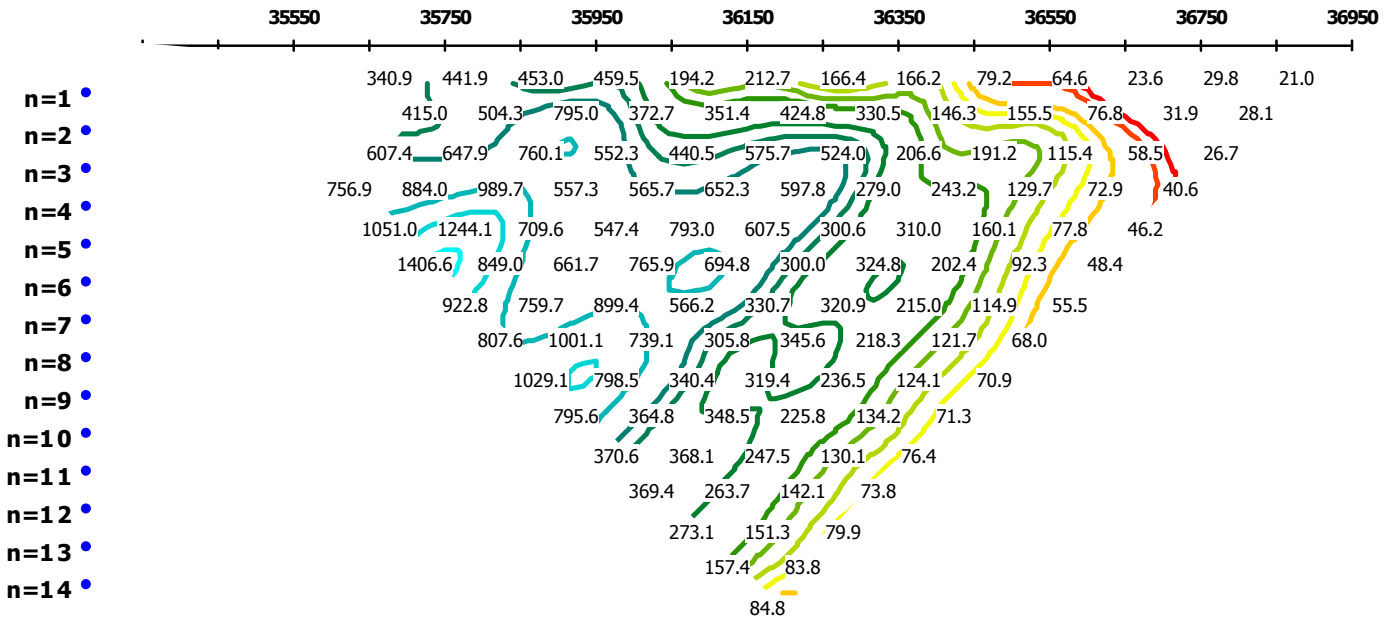

Observed Chargeability (mV/V)

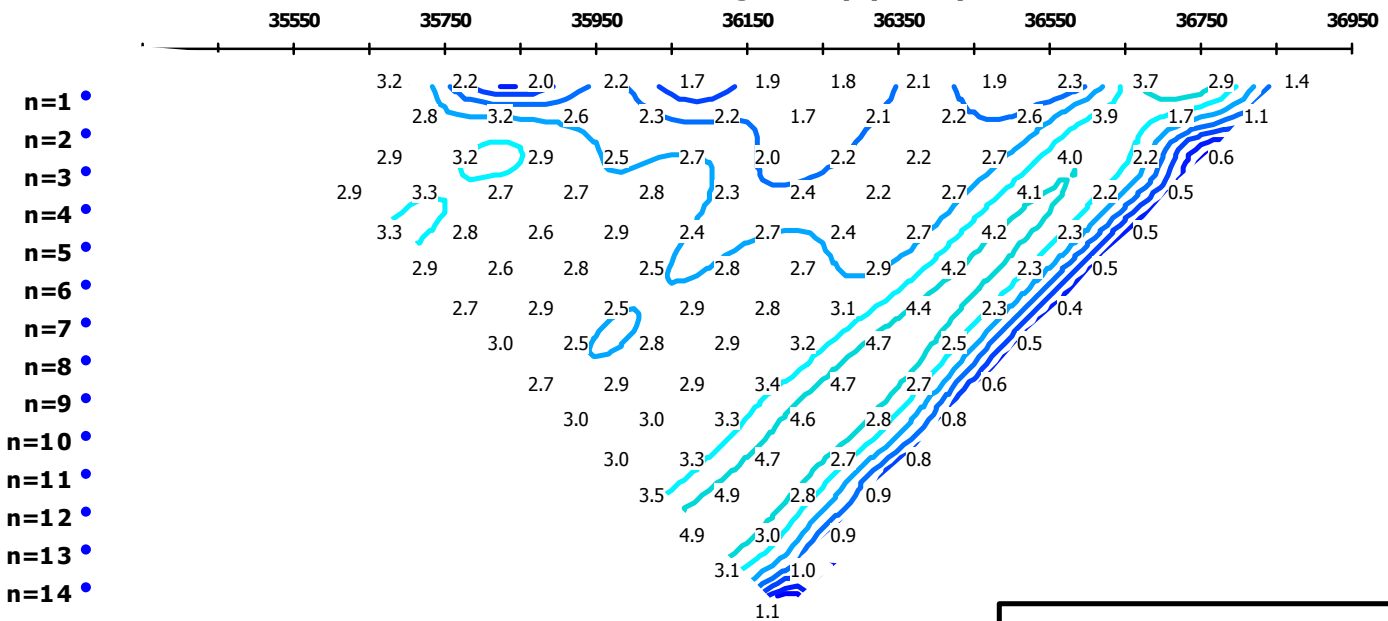

Pole-Dipole Array



$\alpha = 100.0$ (Resistivity & IP Contours at: 1, 1.25, 1.6, 2, 2.5, 3, 2.5, 6, 5, 8, 10, ...)

SANDFIRE RESOURCES NL

Borroloola Project
Line 558800E

Pole-Pole MIMDAS Data
GRS Pty Ltd