




Observed Apparent Resistivity (Ohm.m)

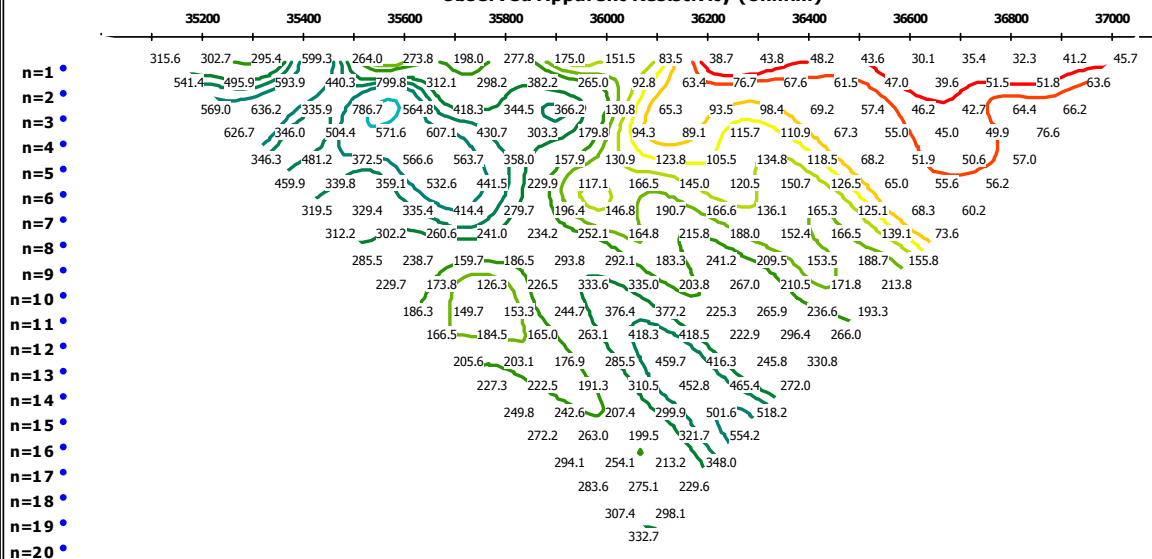

Observed Chargeability (mV/V)

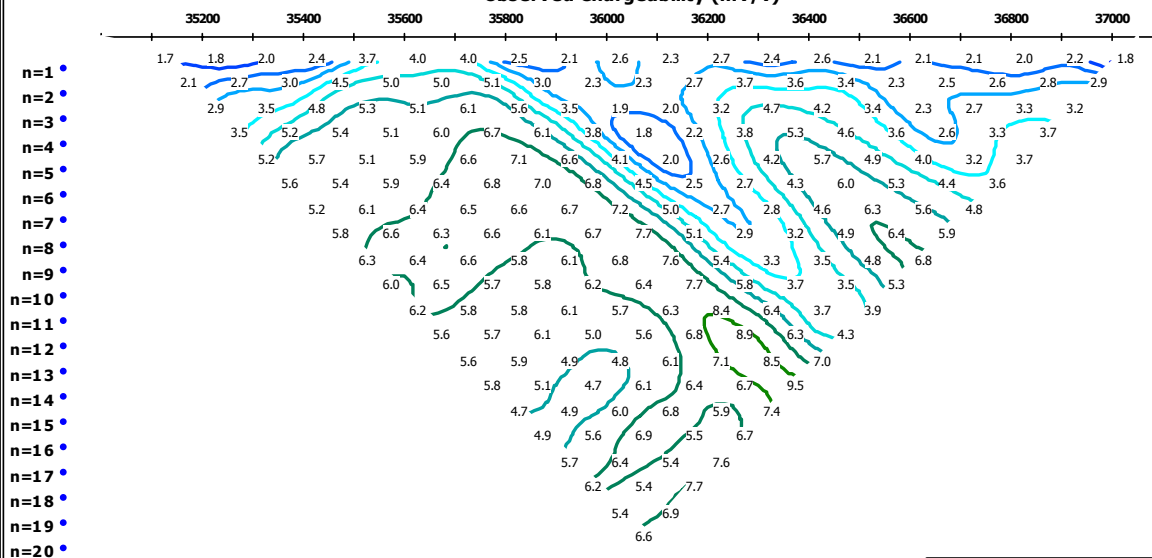

Dipole-Pole Array



$\alpha = 100$. (Resistivity & IP Contours at: 1,1.25,1.6,2,2.5,3,2.5,6,5,8,10...

SANDFIRE RESOURCES NL

Borroloola Project
Line 557300E

Dipole-Pole MIMDAS Data
GRS Pty Ltd