




### Observed Apparent Resistivity (Ohm.m)

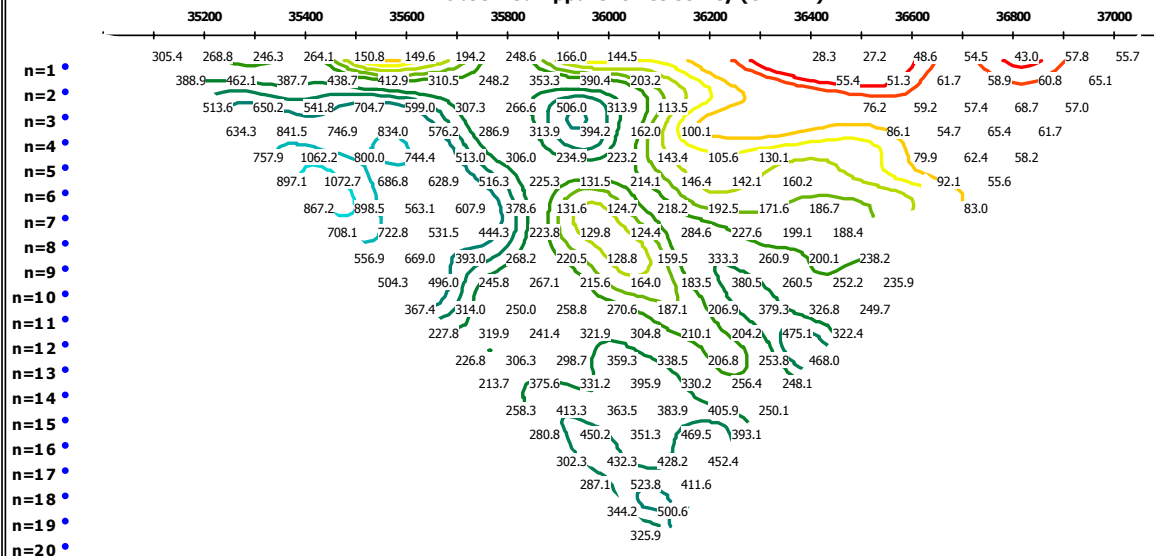

### Observed Chargeability (mV/V)

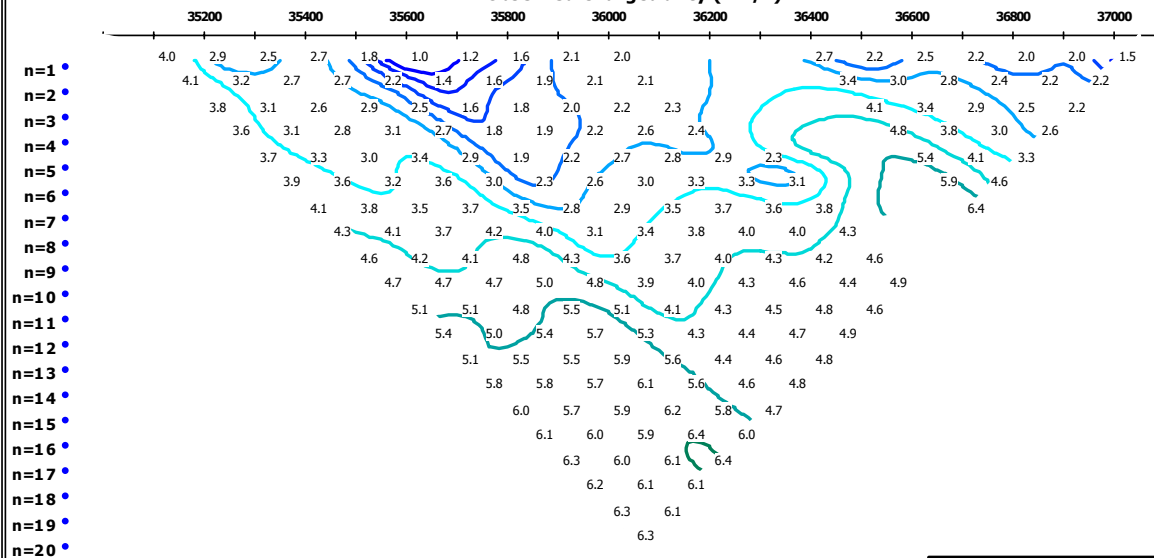

### Dipole-Pole Array



a = 100. (Resistivity & IP Contours at: 1,1.25,1.6,2,2.5,3,2.5,6,5,8,10...

SANDFIRE RESOURCES NL

Borroloola Project  
Line 557800E

Dipole-Pole MIMDAS Data  
GRS Pty Ltd