




Observed Apparent Resistivity (Ohm.m)

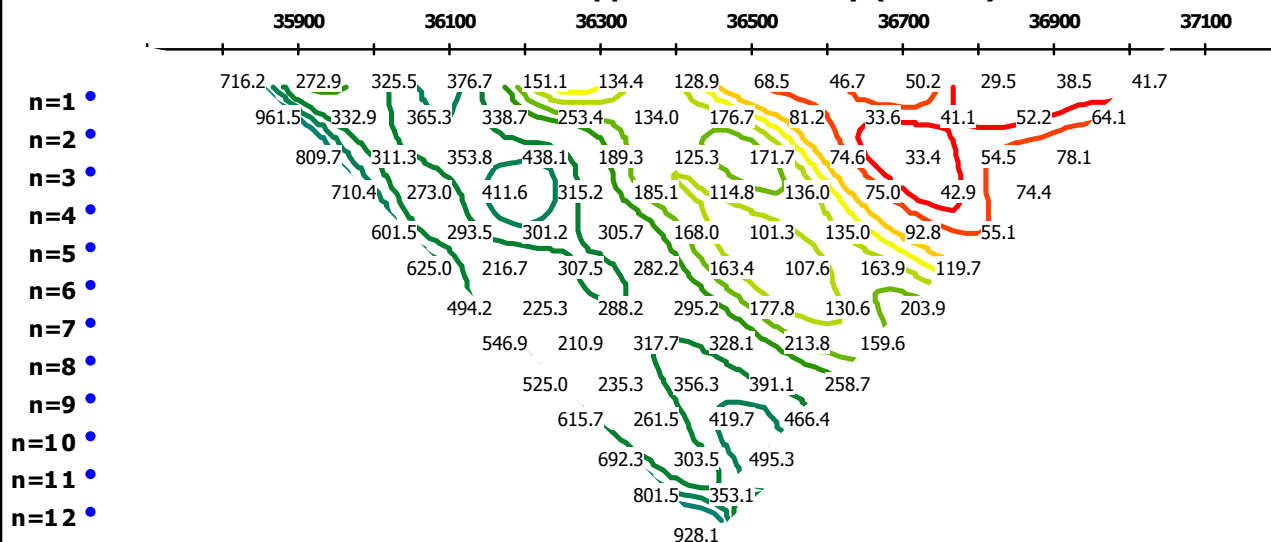

Observed Chargeability (mV/V)

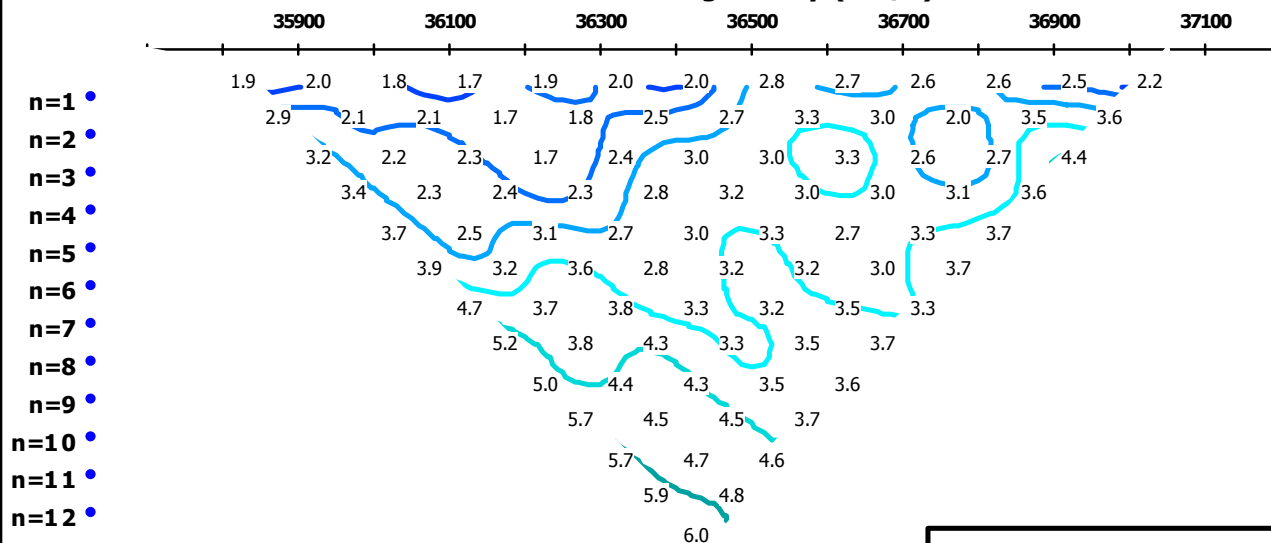

Dipole-Pole Array



a = 100. C Resistivity & IP Contours at : 1,1.25,1.6,2,2.5,3.2,5,6.5,8,10...

SANDFIRE RESOURCES NL

Borroloola Project
Line 558800E

Dipole-Pole MIMDAS Data
GRS Pty Ltd